


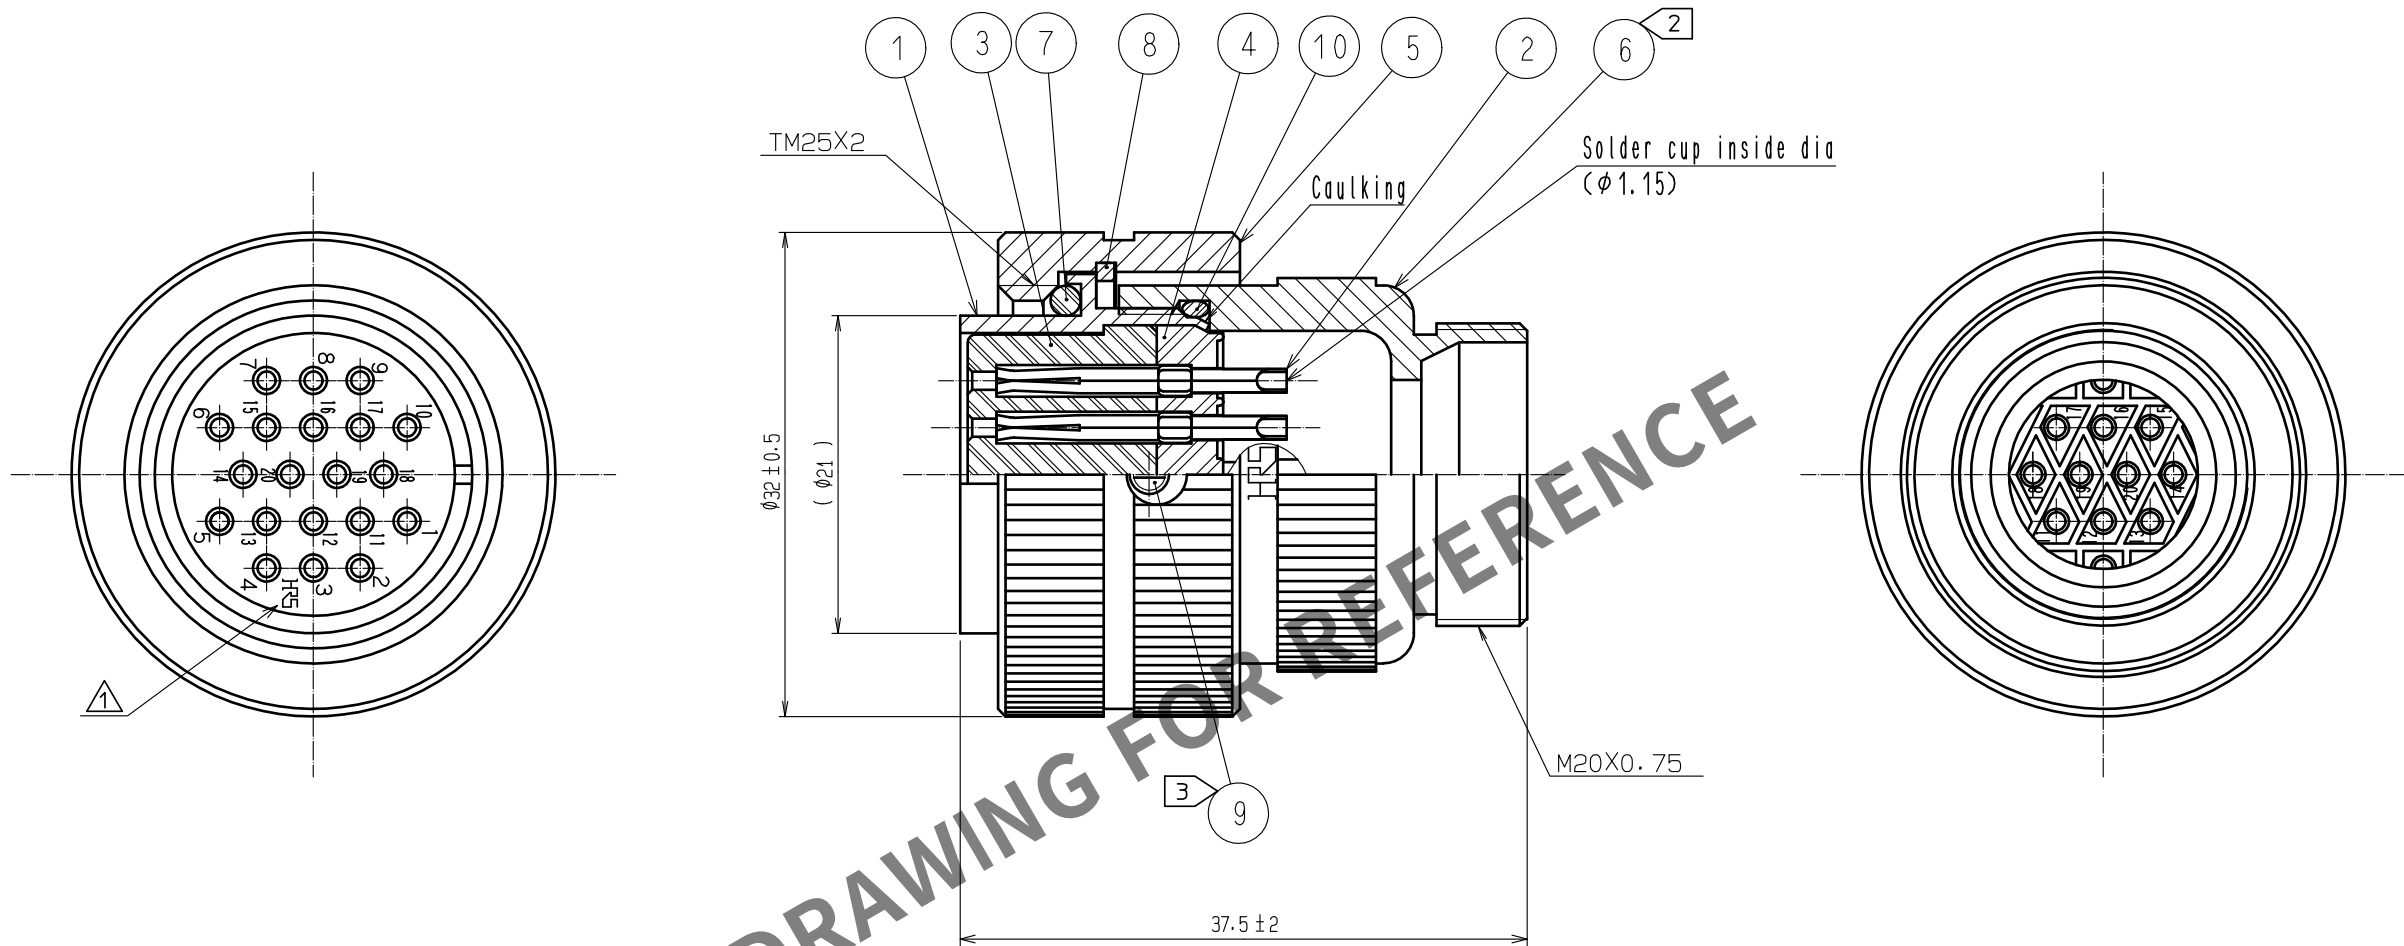

- NOTES 1 ONE EXAMPLE OF THE ROTATION OF REF. ⑥ TO REF. NO. ① IS SHOWN.
2 THE RECOMMENDED TIGHTENING TORQUE OF REF. NO. ⑥ SHALL BE 2 TO 3N · m.
3 THE RECOMMENDED TIGHTENING TORQUE OF REF. NO. ③ SHALL BE 0.2 TO 0.3N · m.
4 THIS PRODUCTS TO BE USED WITH CABLE CLAMP, RM21WTP-CP(*) (71).
*DESIGNATE DIAMETER(mm) OF APPLICABLE CABLE.

5	BRASS	NICKEL PLATING	10	CHLOROPRENE RUBBER	(BLACK)
4	PPS	(BLACK) UL94V-0	9	BRASS	NICKEL PLATING
3	PPS	(BLACK) UL94V-0	8	PHOSPHOR BRONZE	NICKEL PLATING
2	COPPER ALLOY	SILVER PLATING 5 μm min.	7	CHLOROPRENE RUBBER	(BLACK)
1	BRASS	NICKEL PLATING	6	BRASS	NICKEL PLATING
NO.	MATERIAL	FINISH . REMARKS	NO.	MATERIAL	FINISH . REMARKS
UNITS mm		SCALE 2 : 1	COUNT 1	DESCRIPTION OF REVISIONS DIS-C-00003596	DESIGNED TH. KAMEYA
HIROSE ELECTRIC CO., LTD.		APPROVED : HY. KOBAYASHI	20180222	DRAWING NO.	EDC-110103-31-00
		CHECKED : HY. KOBAYASHI	20180222	PART NO.	RM21WTP-20S(31)
		DESIGNED : HY. KISHI	20180222	CODE NO.	CL109-1402-5-31
		DRAWN : MK. INOUE	20180208		